



NOTES:


1. Concrete : 5,000 P.S.I  
Minimum Strength @ 28 Days
2. Steel Reinforcing– ASTM A-615,  
Grade 60.
3. Cover to Steel–1" Minimum
4. Vault are Designed to Meet ASTM  
C858 and ACI 318 with AASHTO  
HS-20 Loading
5. Earth Cover –0 to 5 Feet Max.  
Minimum
6. Construction Joint–Sealed with  
1" Dia Butyl Rubber or Equivalent
7. Wall Thickness Available in 6", 8" &  
10"

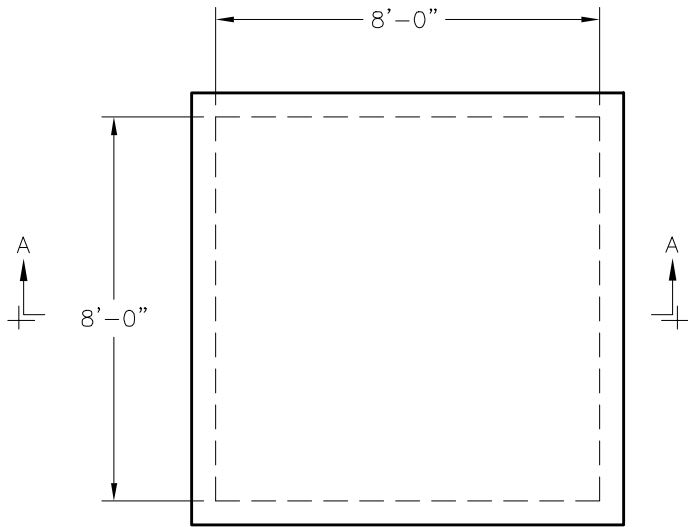

**PLAN VIEW**

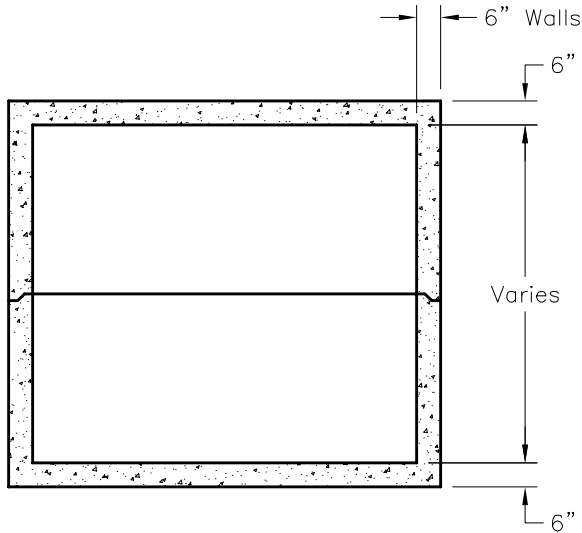

**SECTION A-A**

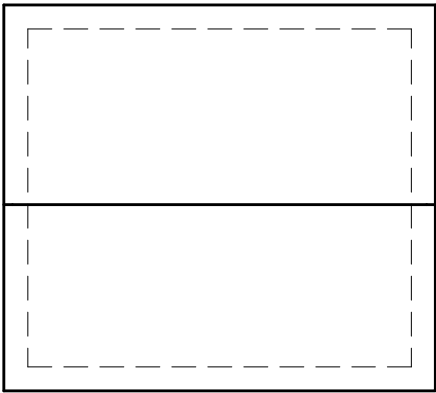

**END VIEW**



**MH8X8**

FILE NAME: 324UCPMH8X8\_DET.DWG

ISSUE DATE: January, 2008

[www.oldcastleprecast.com](http://www.oldcastleprecast.com)

**8'-0" x 8'-0" x Variable I.D.  
Utility Vault**

Copyright ©2008 **Oldcastle** Precast®